

APPENDIX "A" REQUIREMENTS FOR TEMPORARY SERVICE FROM OVERHEAD SYSTEM

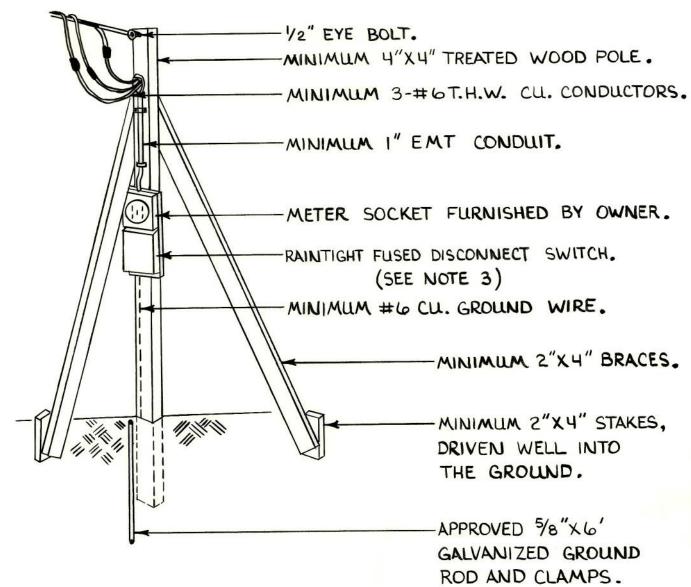

NOTES:

- (1.) DISTANCE TO G.L.P. SECONDARY POLE SHALL NOT BE MORE THAN 100' FOR 100 AMP OR SMALLER SERVICES AND NOT MORE THAN 75' FOR 150 AMP AND 200 AMP SERVICES. FOR SERVICES LARGER THAN 200 AMP CONSULT WITH G.P.L. ENGINEERS.
- (2.) A MINIMUM CLEARANCE OF 18' IS REQUIRED OVER COMMERCIAL DRIVEWAYS OR PARKING LOTS. MINIMUM OF 22' REQUIRED OVER PUBLIC STREETS.
- (3.) DUAL ELEMENT FUSES OR CIRCUIT BREAKERS SHALL BE USED IN RAIN-TIGHT ENCLOSURE. NO PLUG-TYPE FUSES ALLOWED. G.F.I. PROTECTION REQUIRED ON 120 V. RECEPTACLE.
- (4.) CUSTOMER SHALL BE RESPONSIBLE FOR PROVIDING PROPER IDENTIFICATION AT THE SERVICE LOCATION PRIOR TO SERVICE BEING RENDERED.


APPENDIX "B" REQUIREMENTS FOR TEMPORARY SERVICE FROM UNDERGROUND SYSTEM

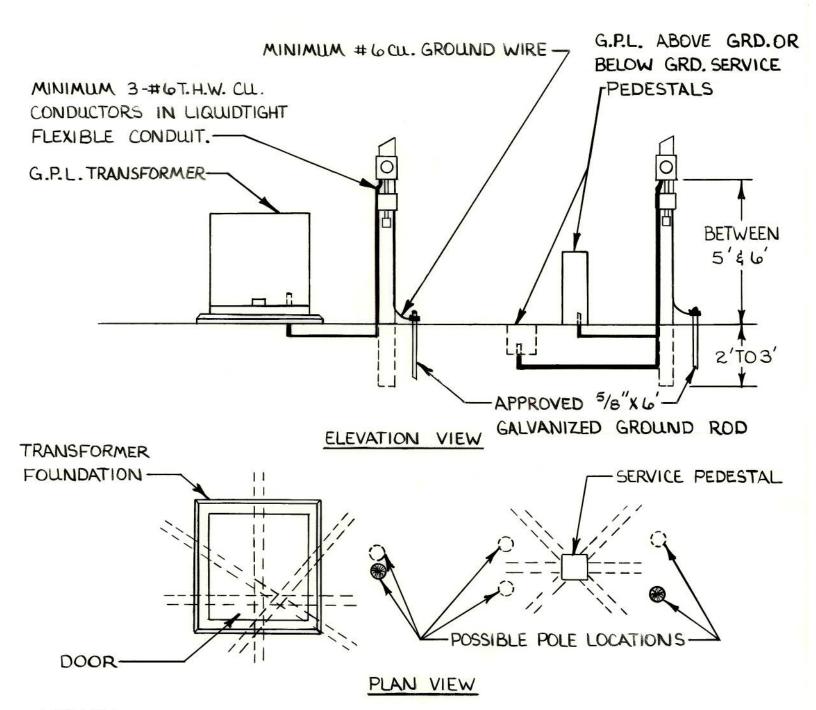

NOTES:

- (I.) DASHED LINES ABOVE ARE APPROXIMATE LOCATIONS OF UNDER-GROUND ENERGIZED CABLES.
- (2.) DUAL ELEMENT FUSES OR CIRCUIT BREAKERS SHALL BE USED IN RAINTIGHT ENCLOSURE. NO PLUG TYPE FUSES ALLOWED. G.F.I. PROTECTION REQUIRED ON 120 V RECEPTACLE.
- (3.) CUSTOMER SHALL BE RESPONSIBLE FOR PROVIDING PROPER IDENTIFICATION AT THE SERVICE LOCATION PRIOR TO SERVICE BEING RENDERED.
- (4.) CUSTOMER TO PROVIDE 36" OF SERVICE ENTRANCE CONDUCTOR BEYOND CONDUIT.

APPENDIX "C" SERVICE ENTERANCE FOR HOUSES WITH ADEQUATE HEIGHT

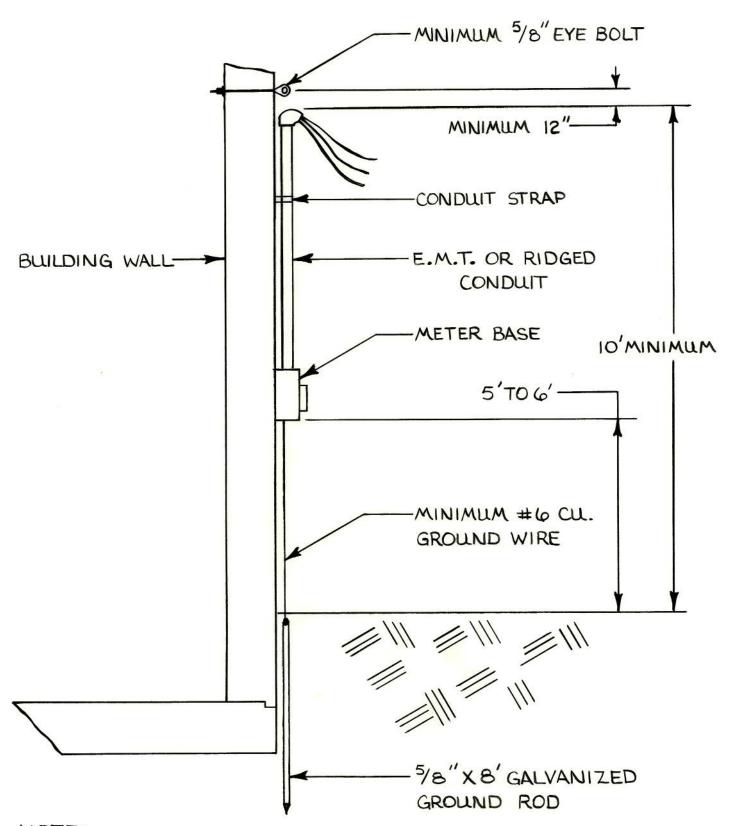


NOTE:

- 1.) EYE BOLT TO BE INSTALLED BY CUSTOMER.
- 2.) MINIMUM 3' CONDUCTOR EXTENDED FROM SERVICE HEAD, WITH NEUTRAL CONDUCTOR PLAINLY IDENTIFIED.

APPENDIX "D"

SERVICE ENTRANCE FOR LOW ROOF HOUSING

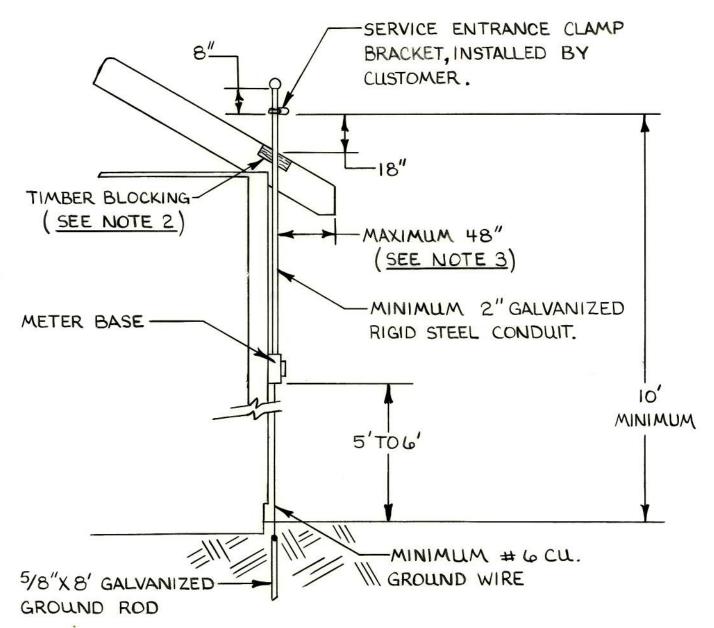

NOTES:

- 1.) A MINIMUM CLEARANCE OF 18' IS REQUIRED OVER COMMERCIAL DRIVEWAYS OR PARKING LOTS AND 22' OVER PUBLIC STREETS.
- 2.) WHERE SERVICE MAST PIERCES THE ROOF, THE ROOF SHALL BE REINFORCED BY 2" X 6" TIMBER. WHERE THE SERVICE IS LONG OR EXTRA HEAVY, THE CHIEF ELECTRICAL INSPECTOR MAY REQUIRE ADDITIONAL SUPPORT TO THE MAST.
- 3.) FOR ROOF OVER HANG OVER 48" CONSULT G.P. & L. ENGINEERS.

APPENDIX "E" RESIDENTIAL U.G. SERVICE

